


**Buffalo Ridge Incremental Outlet:  
 Installed Cost as Function of Outlet  
 Anson Gen = 232 vs. 232 + 170 MW  
 Off-peak Load**



## Buffalo Ridge Incremental Outlet: Installed Cost as Function of Outlet

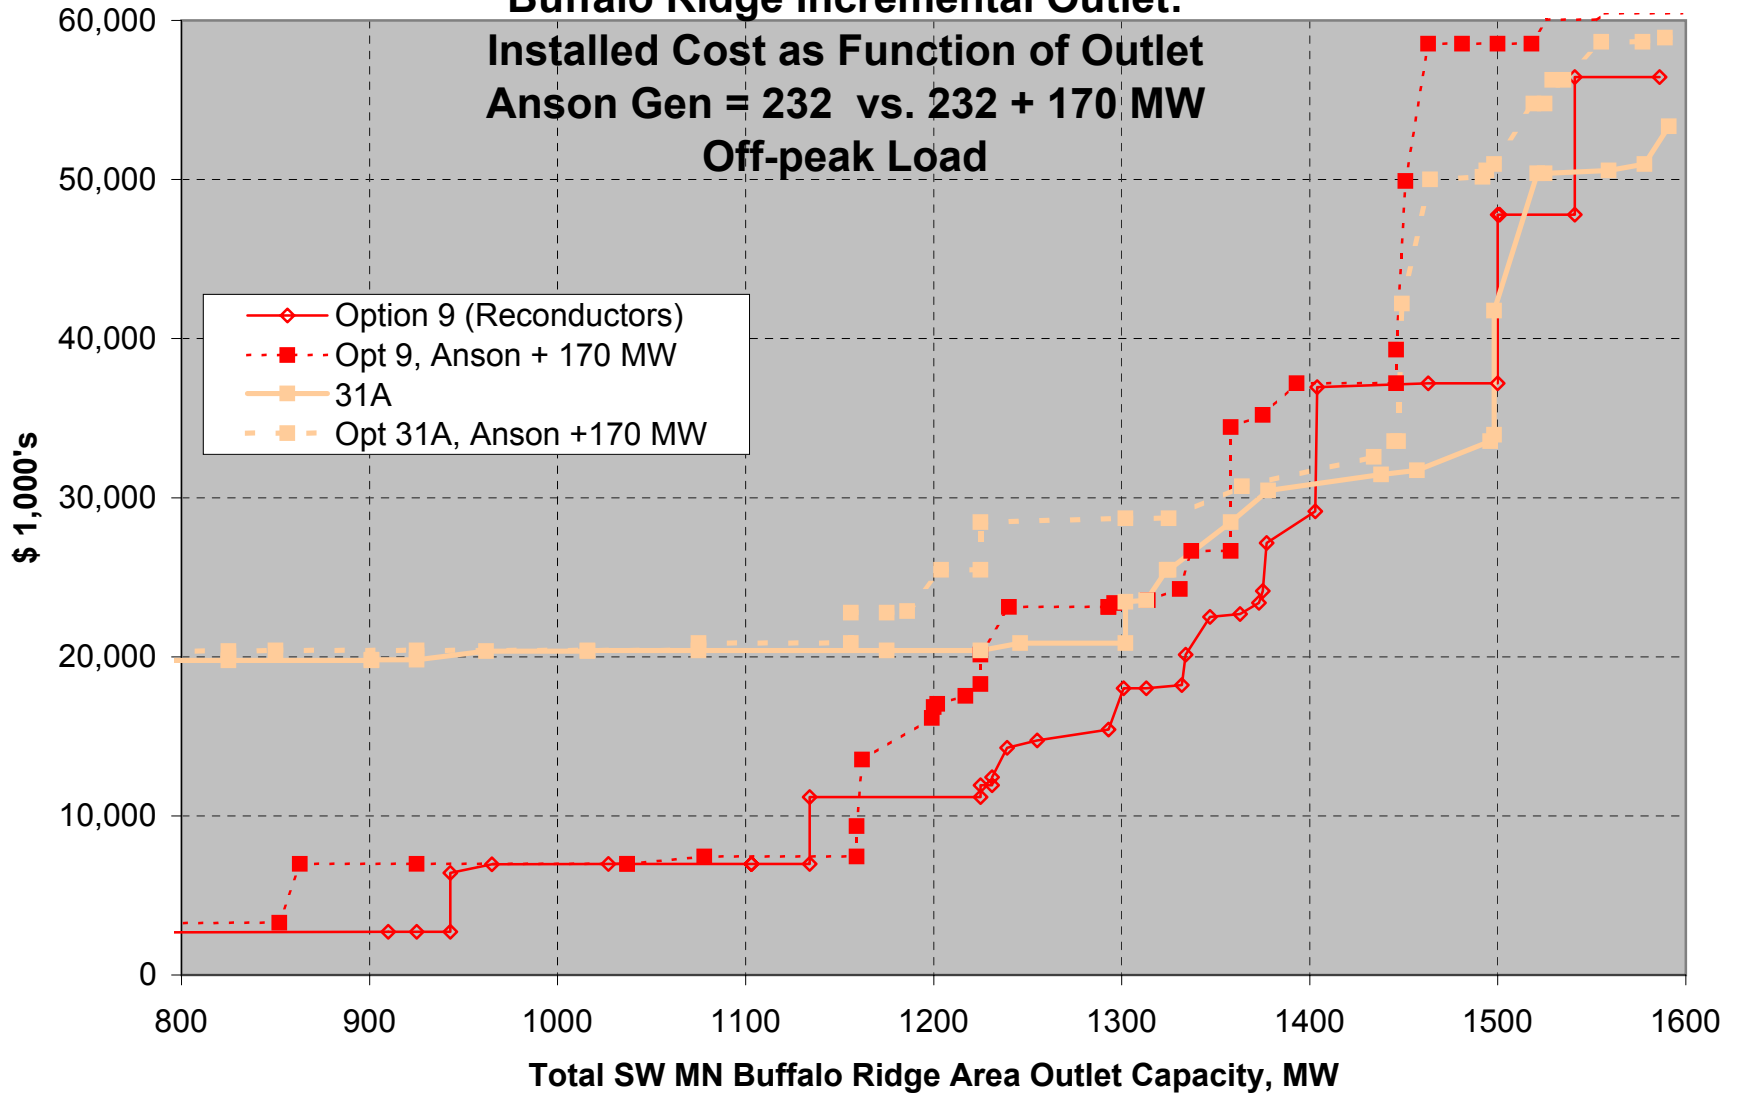