

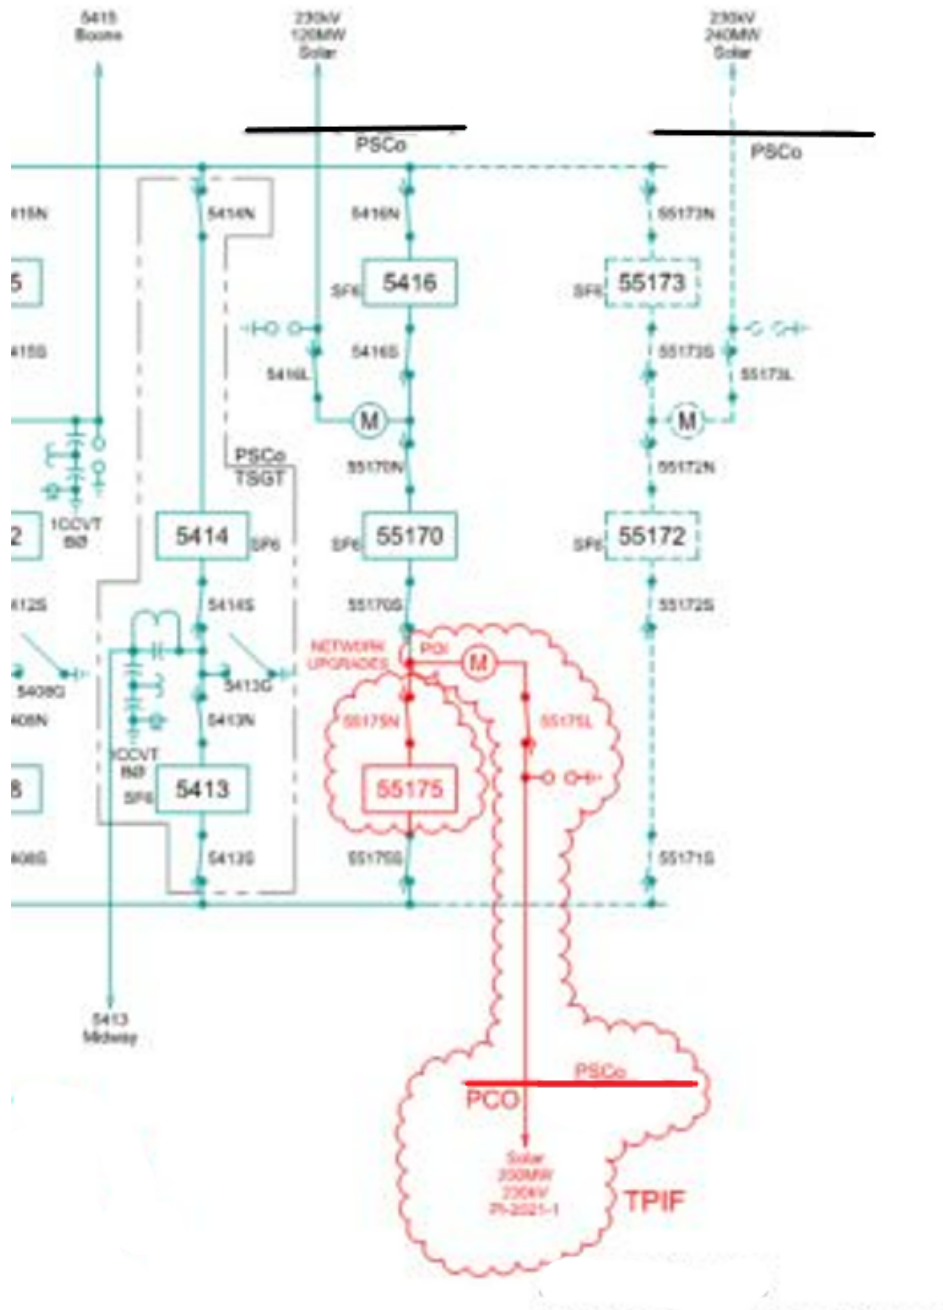
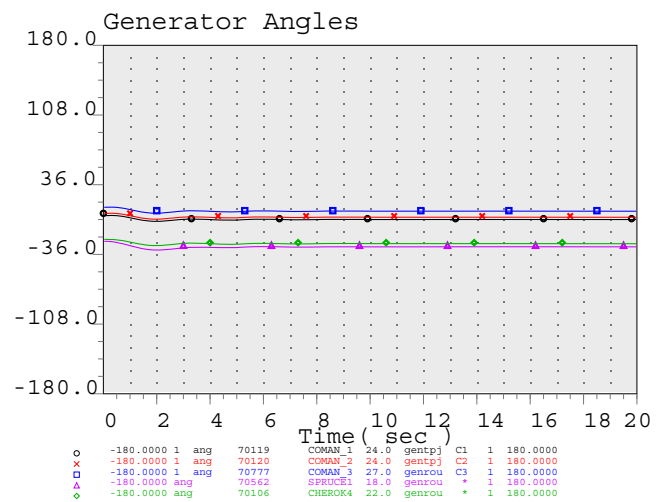
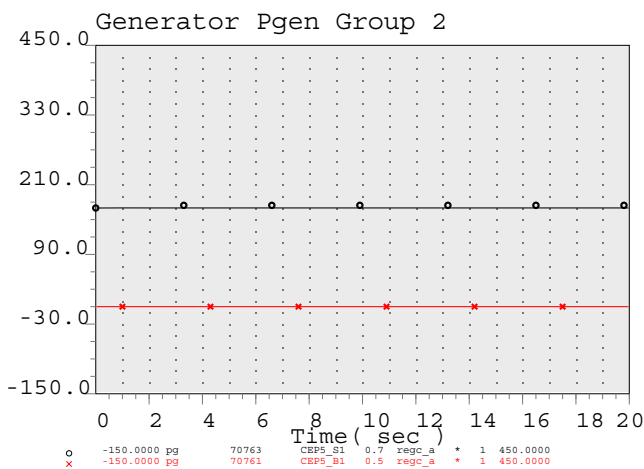
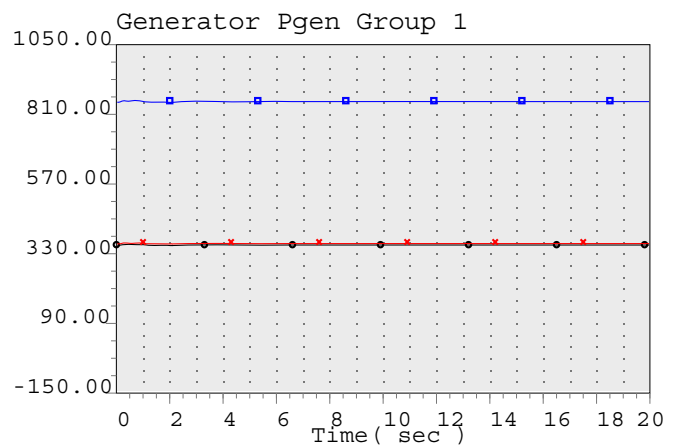
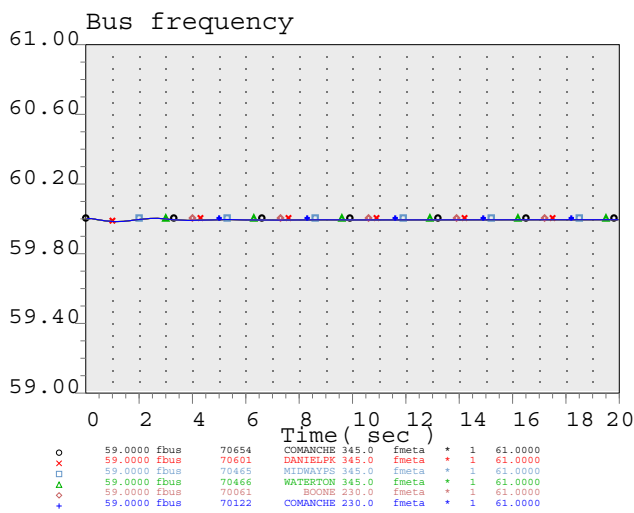


This amendment captures the following corrections to the PI-2021-1 report posted on 7/9/2021. The oneline has been corrected to show the correct Point of Change of Ownership (PCO).






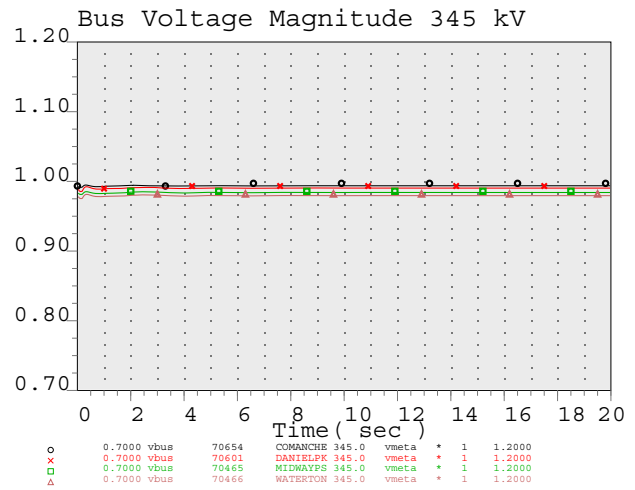


Following are the stability plots missing from the 7/9/2021 report

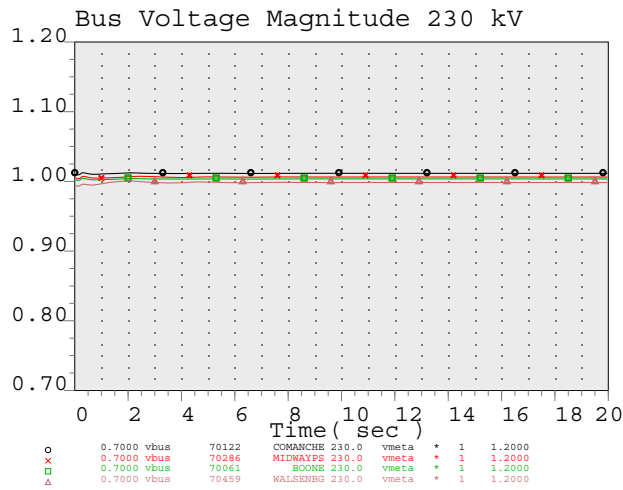







PI-2021-1  
200MW at Comanche 230kV



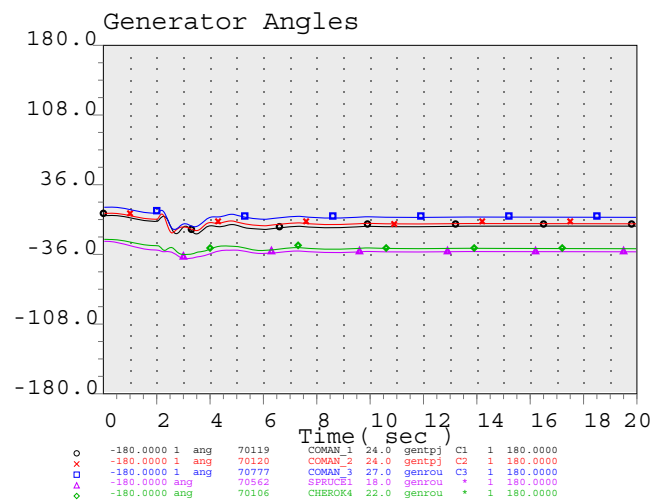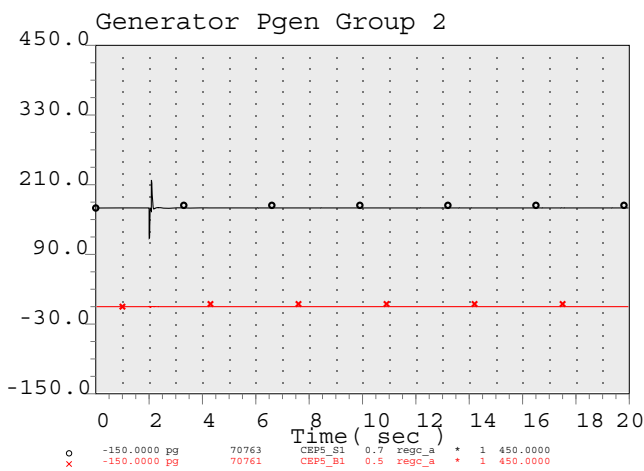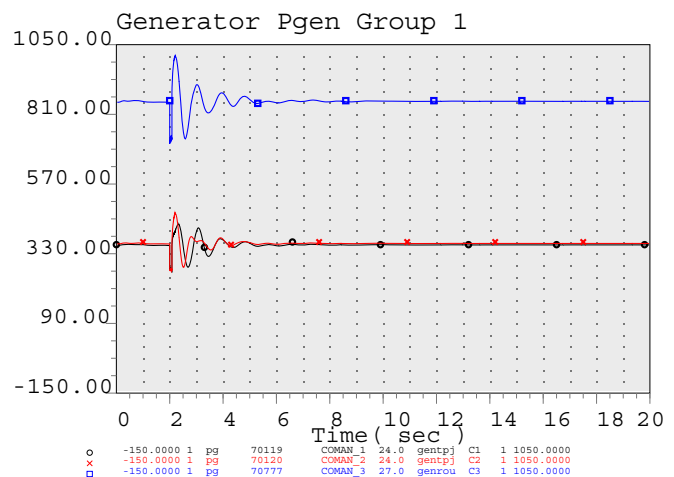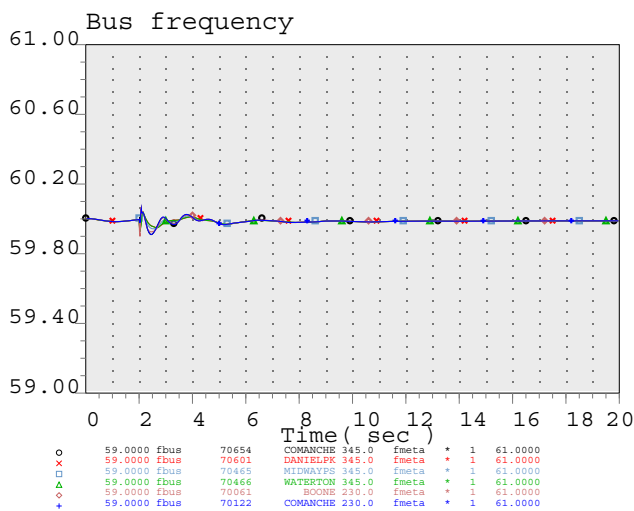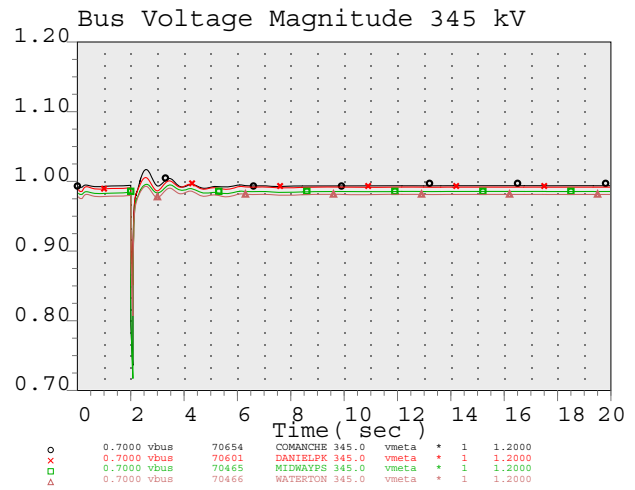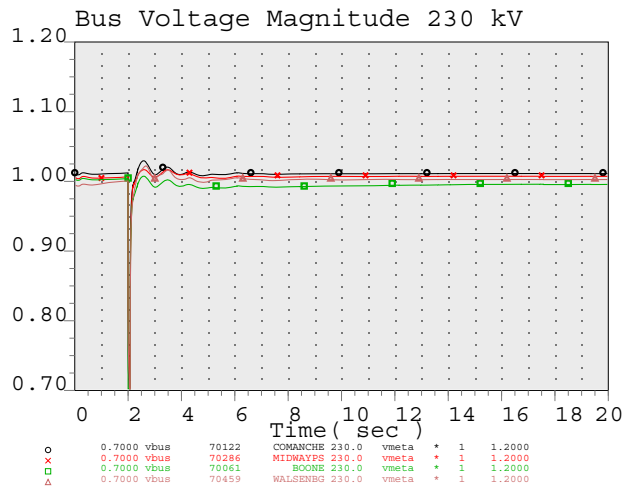







PI-2021-1  
200MW at Comanche 230kV



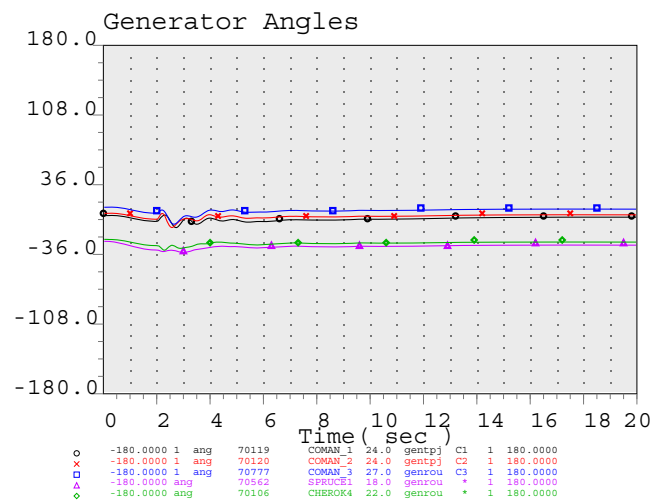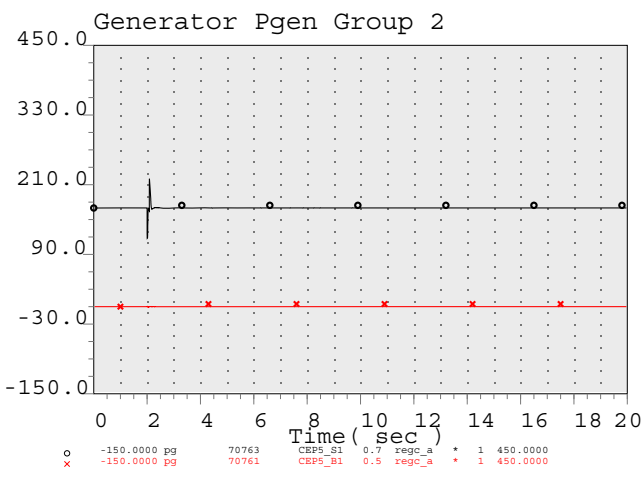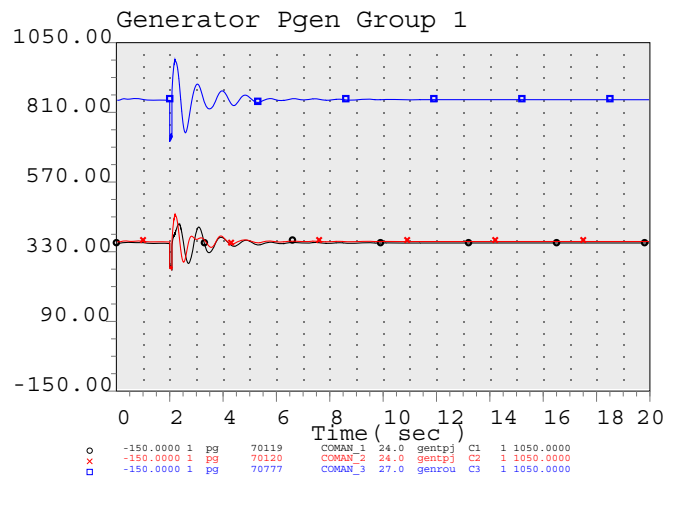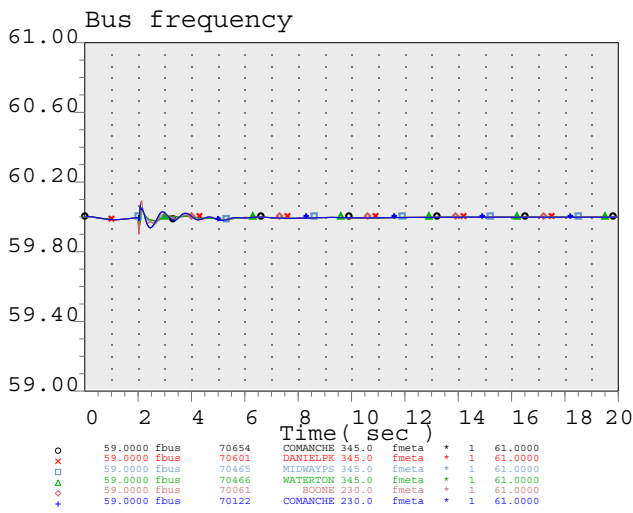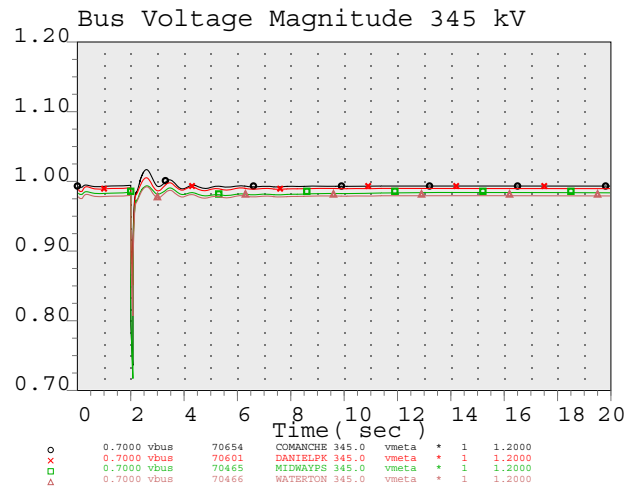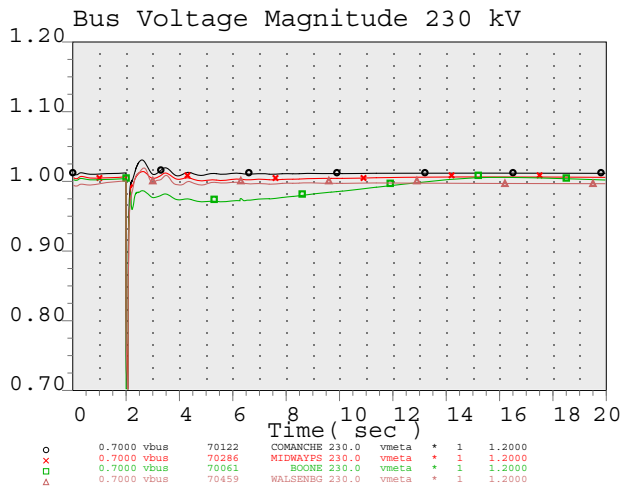







PI-2021-1  
200MW at Comanche 230kV



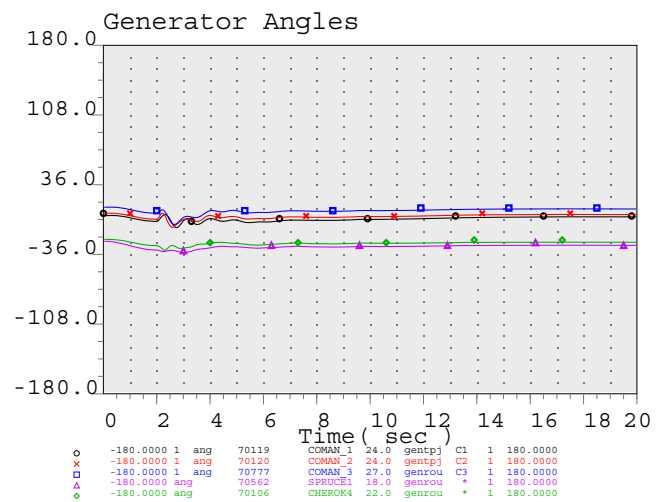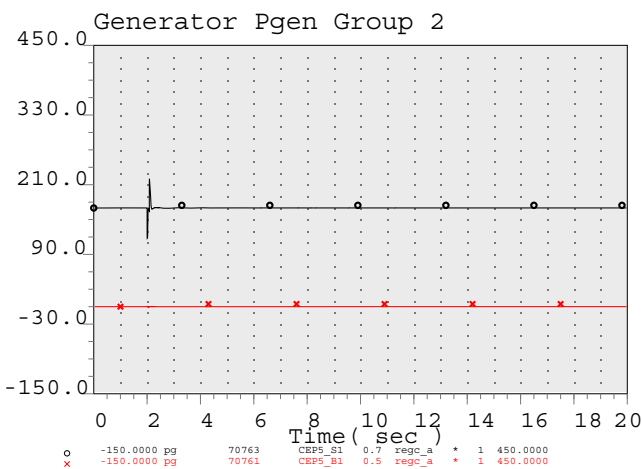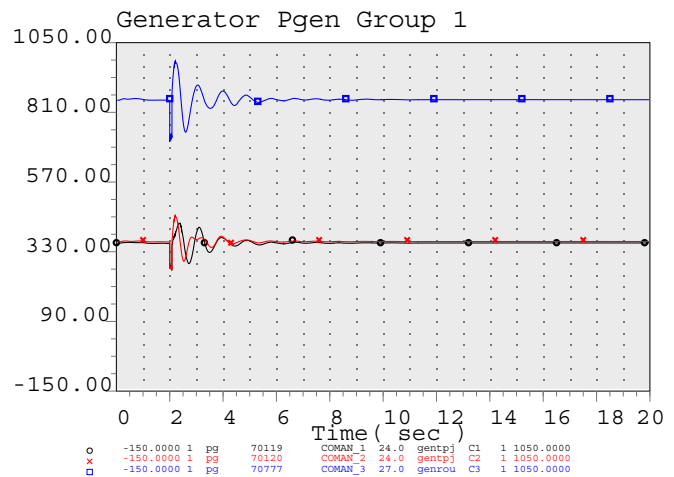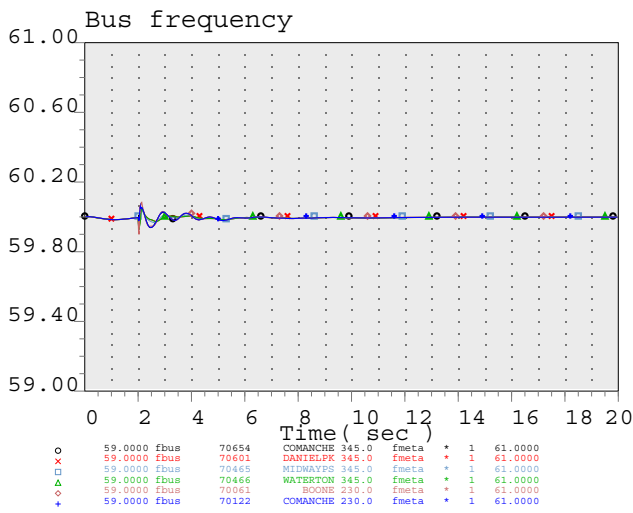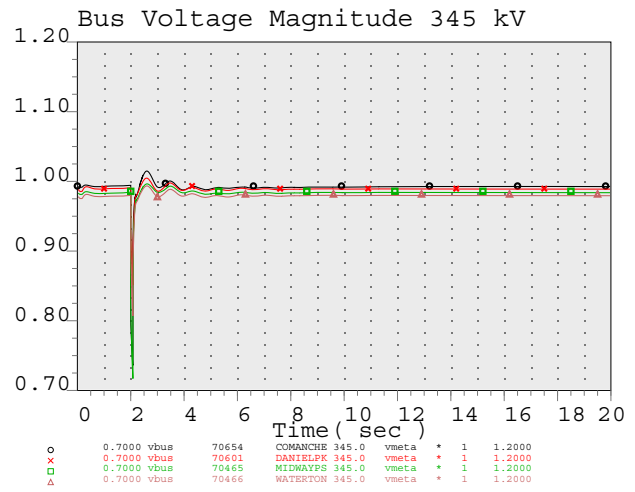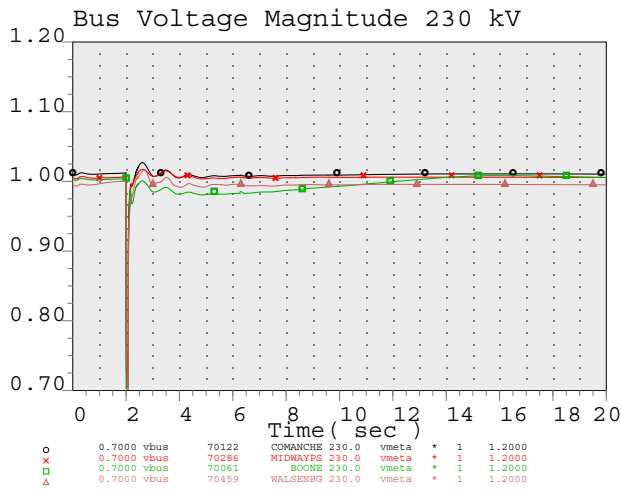







PI-2021-1  
200MW at Comanche 230kV



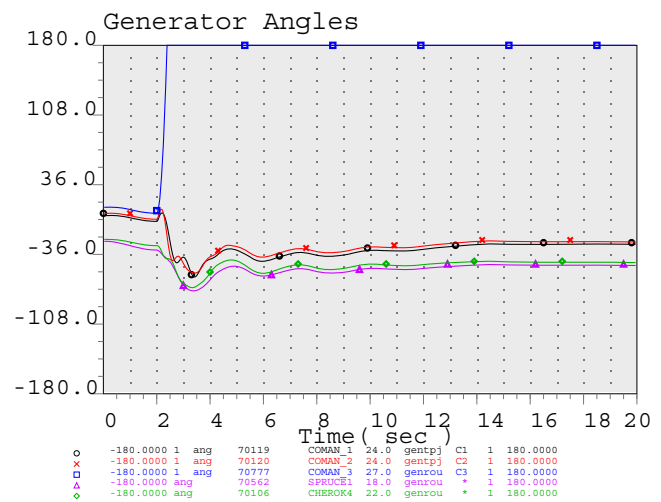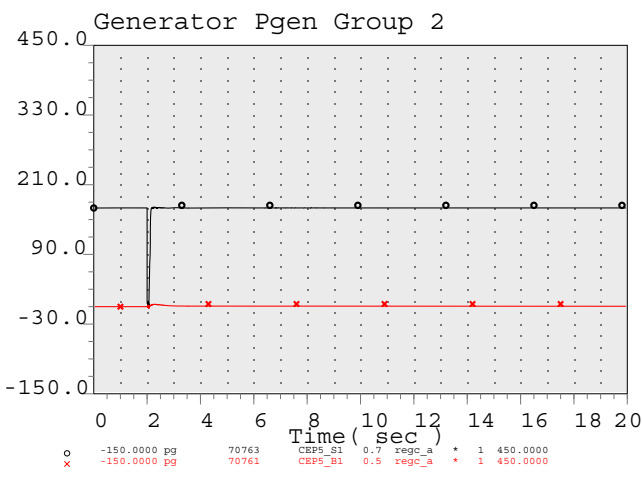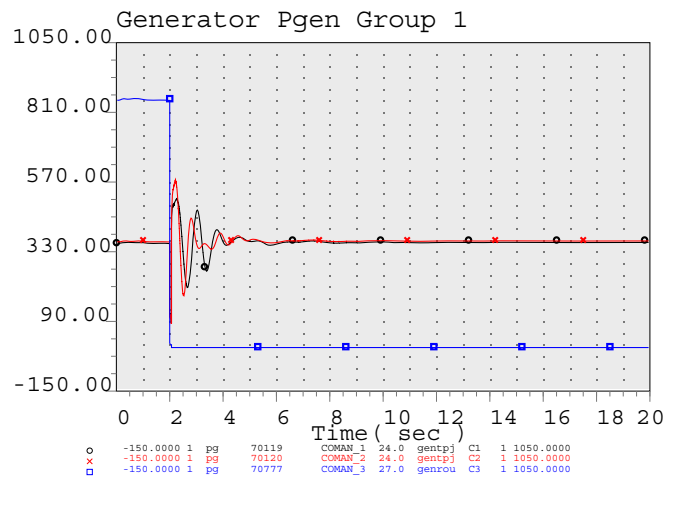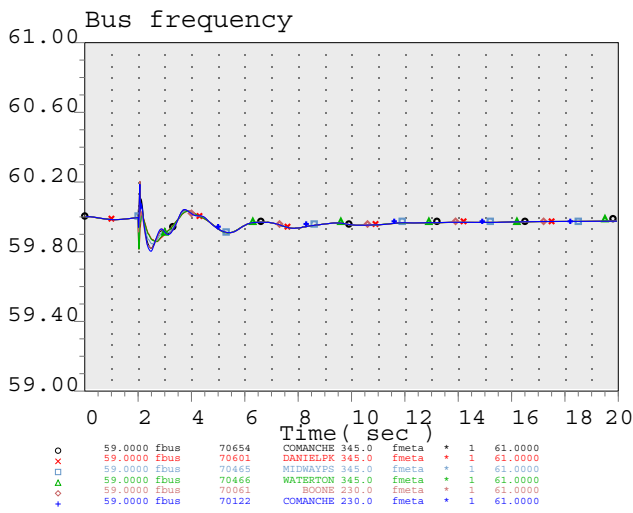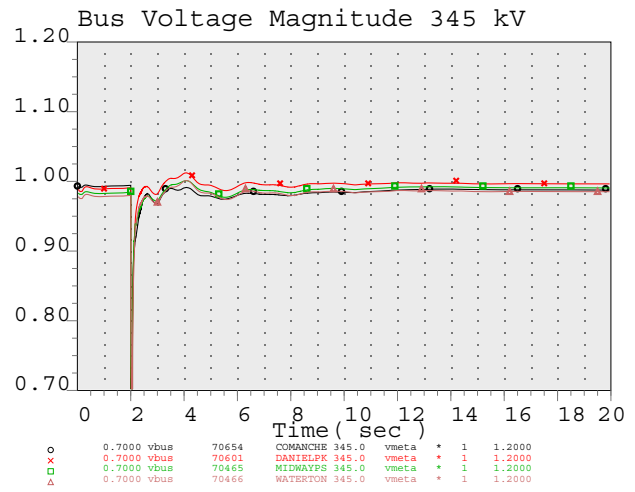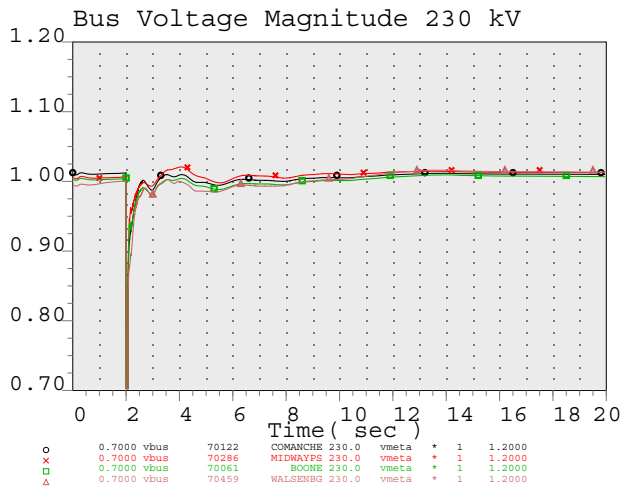

PI-2021-1  
200MW at Comanche 230kV









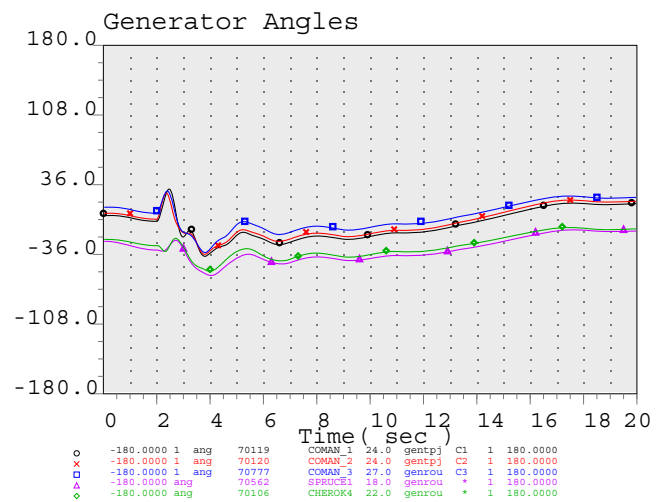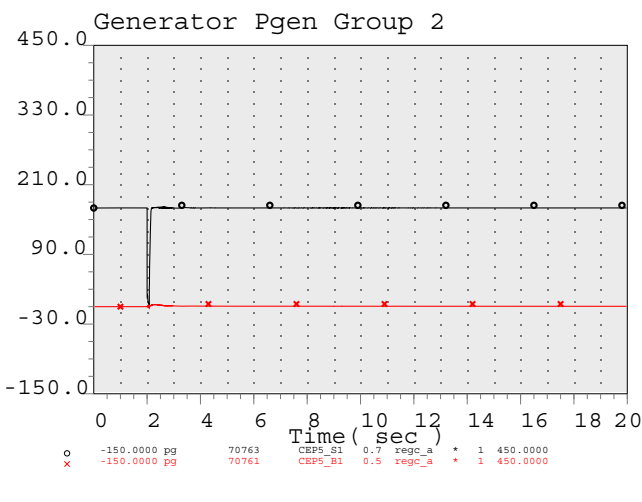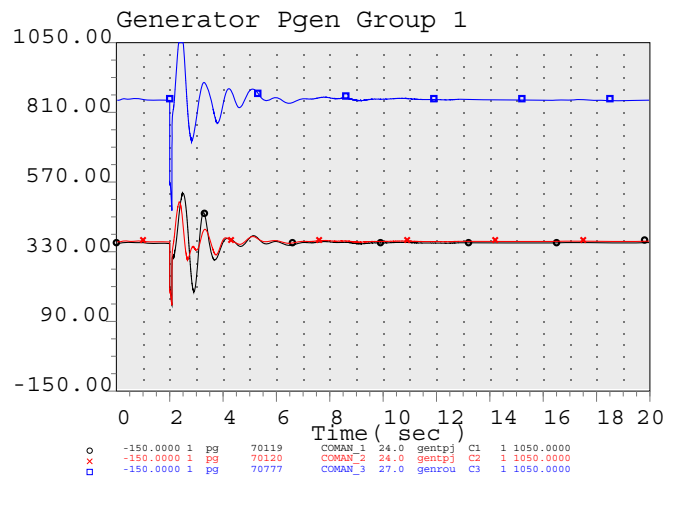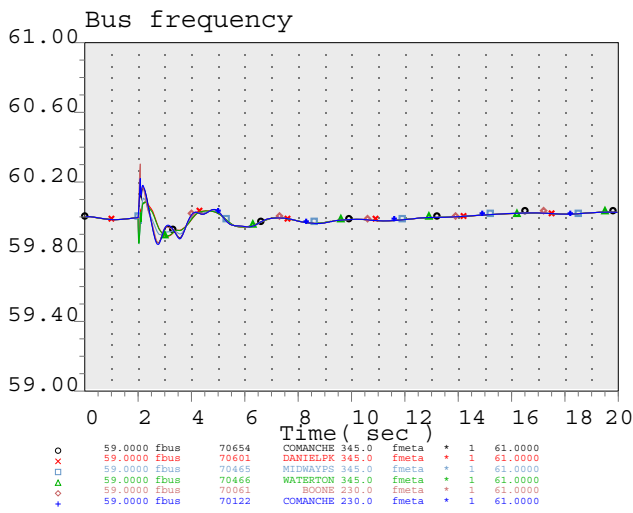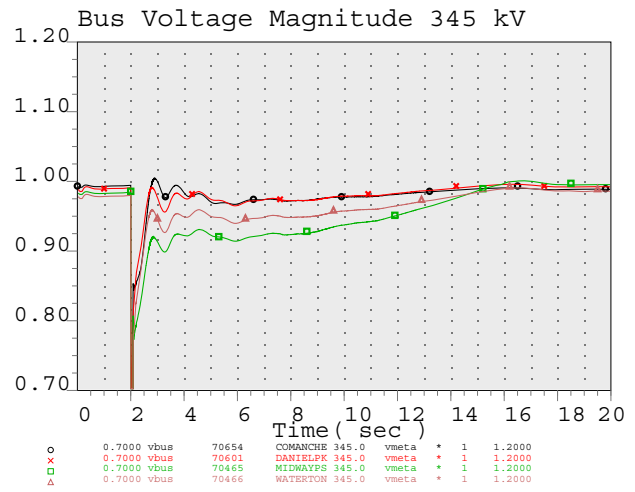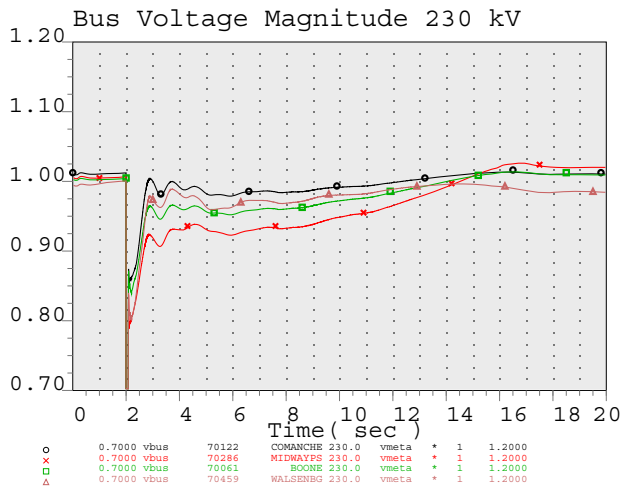

PI-2021-1  
200MW at Comanche 230kV











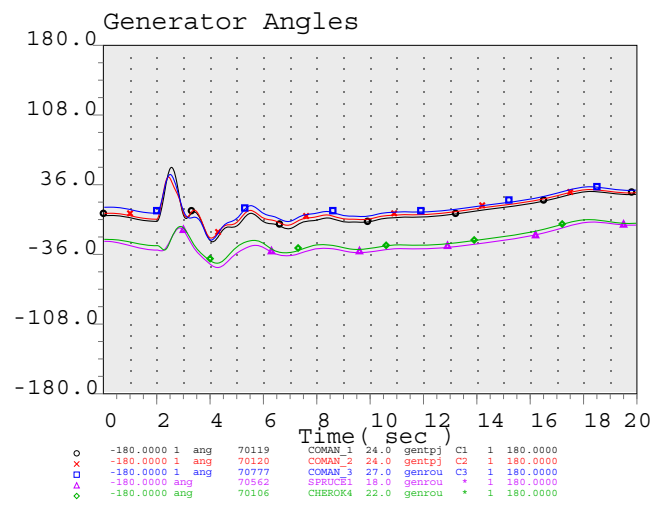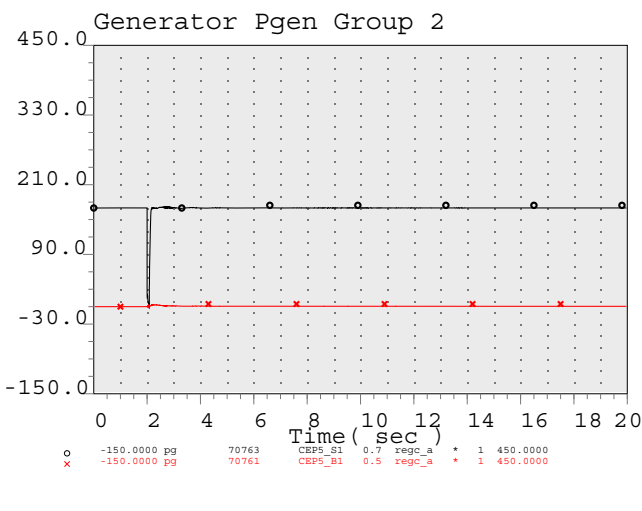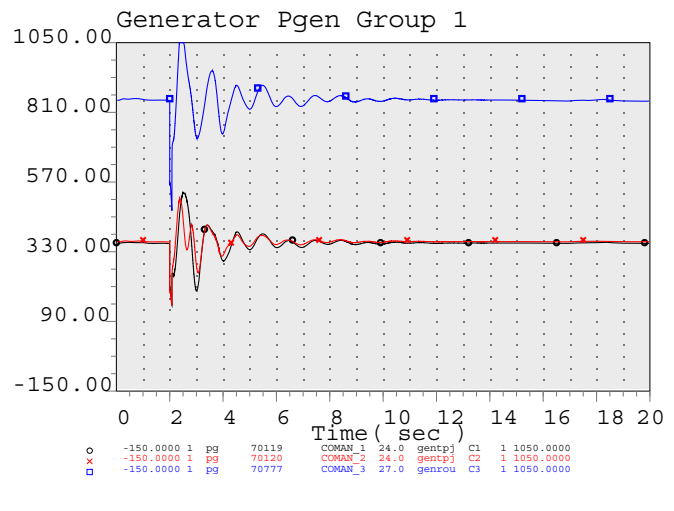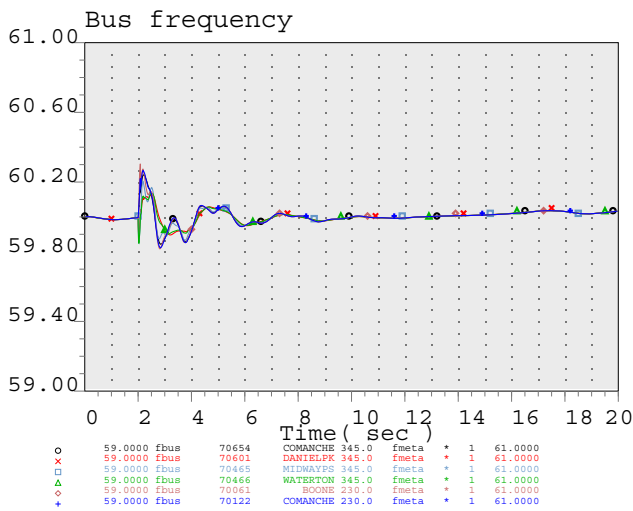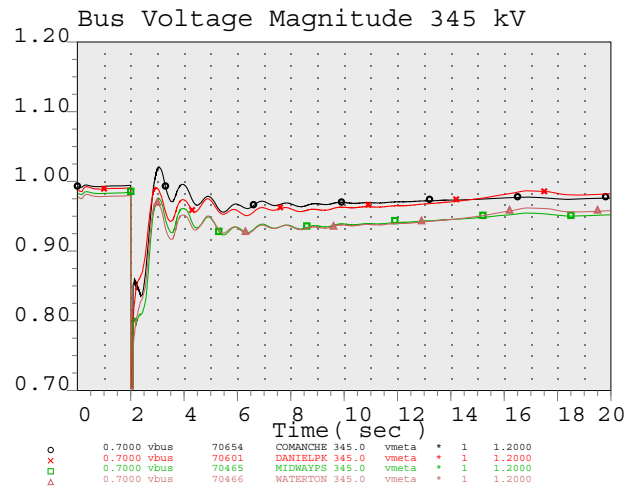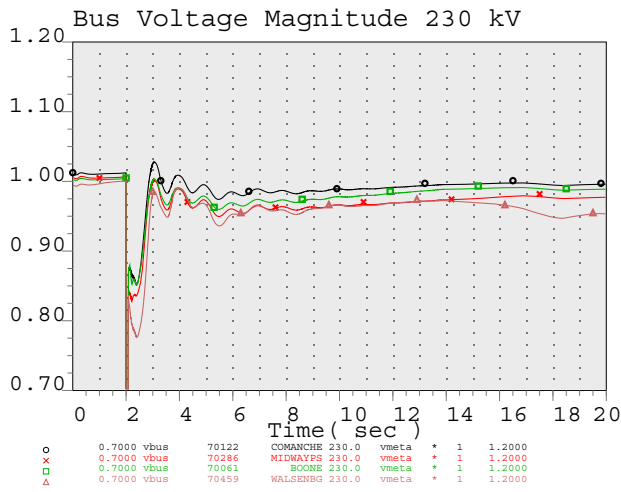

PI-2021-1  
200MW at Comanche 230kV



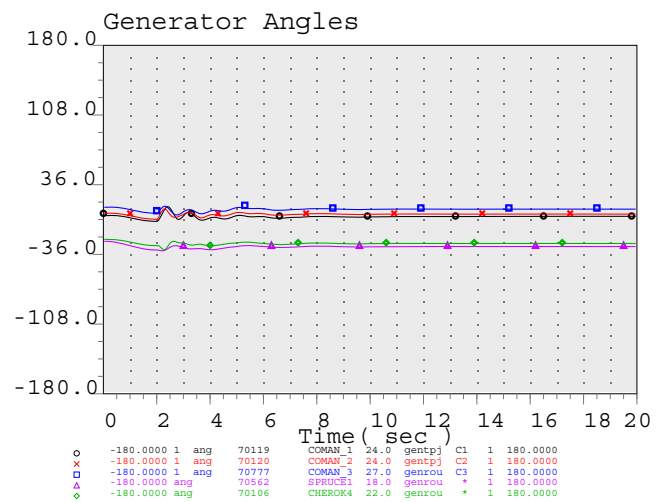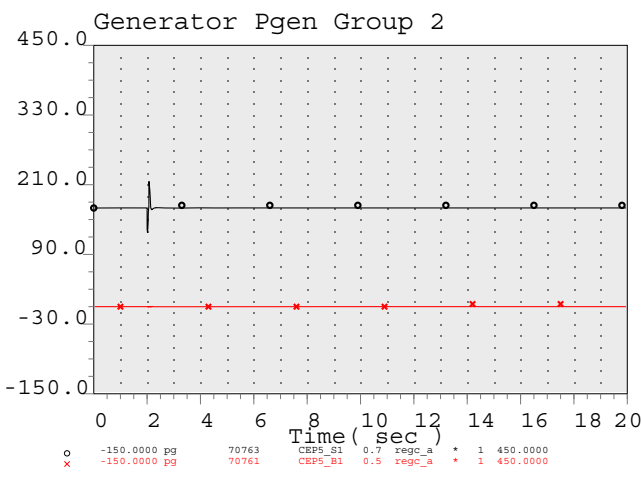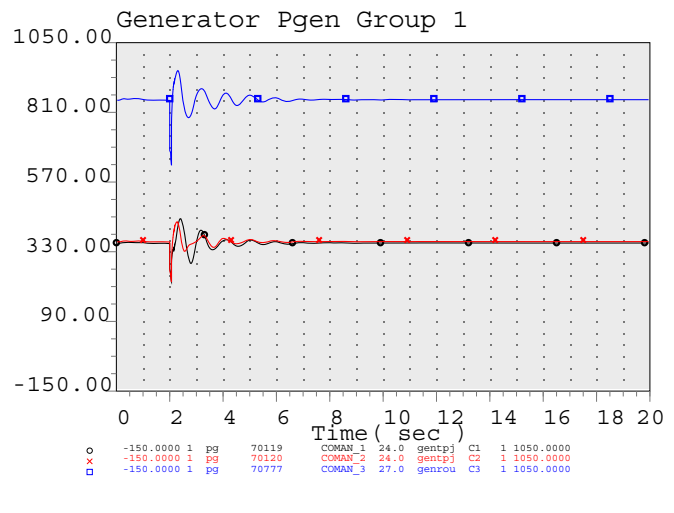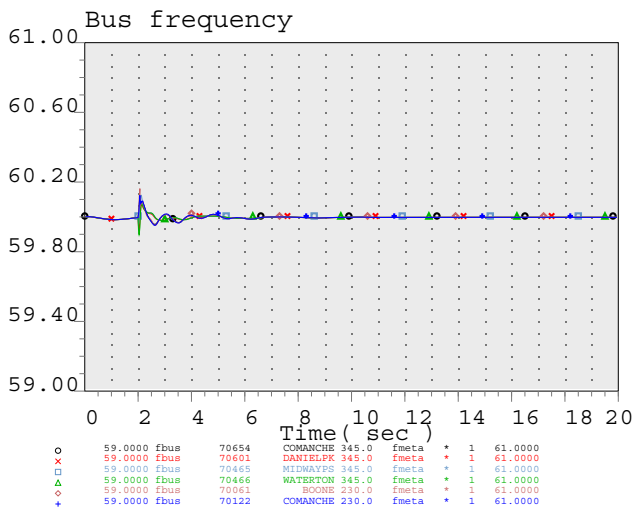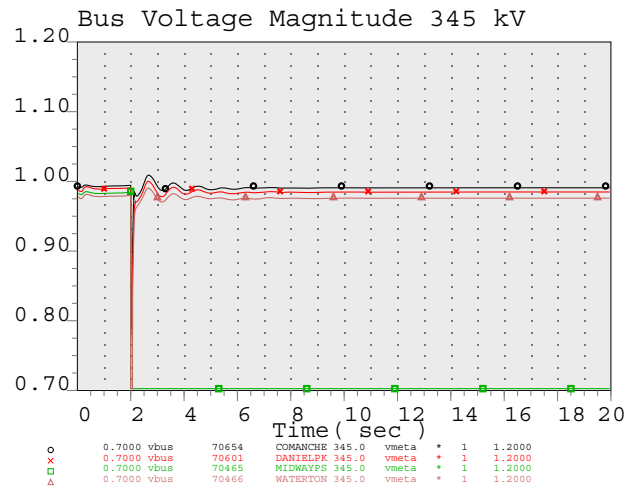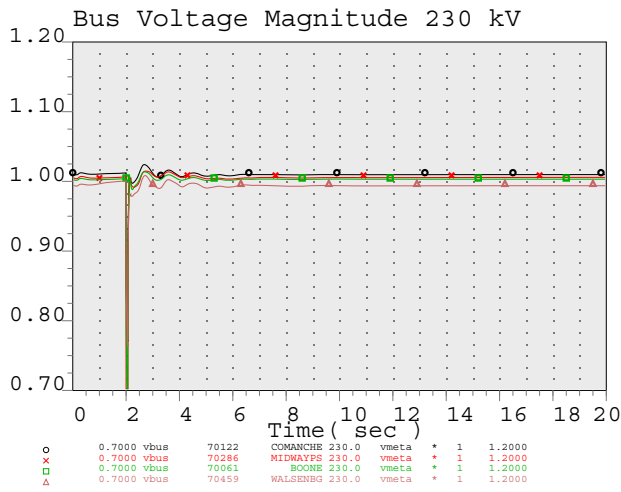

PI-2021-1  
200MW at Comanche 230kV

